


MODEL	RATING	ELEMENT SPLIT	
DR125TLG	2500W 230-240V	II	I
		1250w	1250w

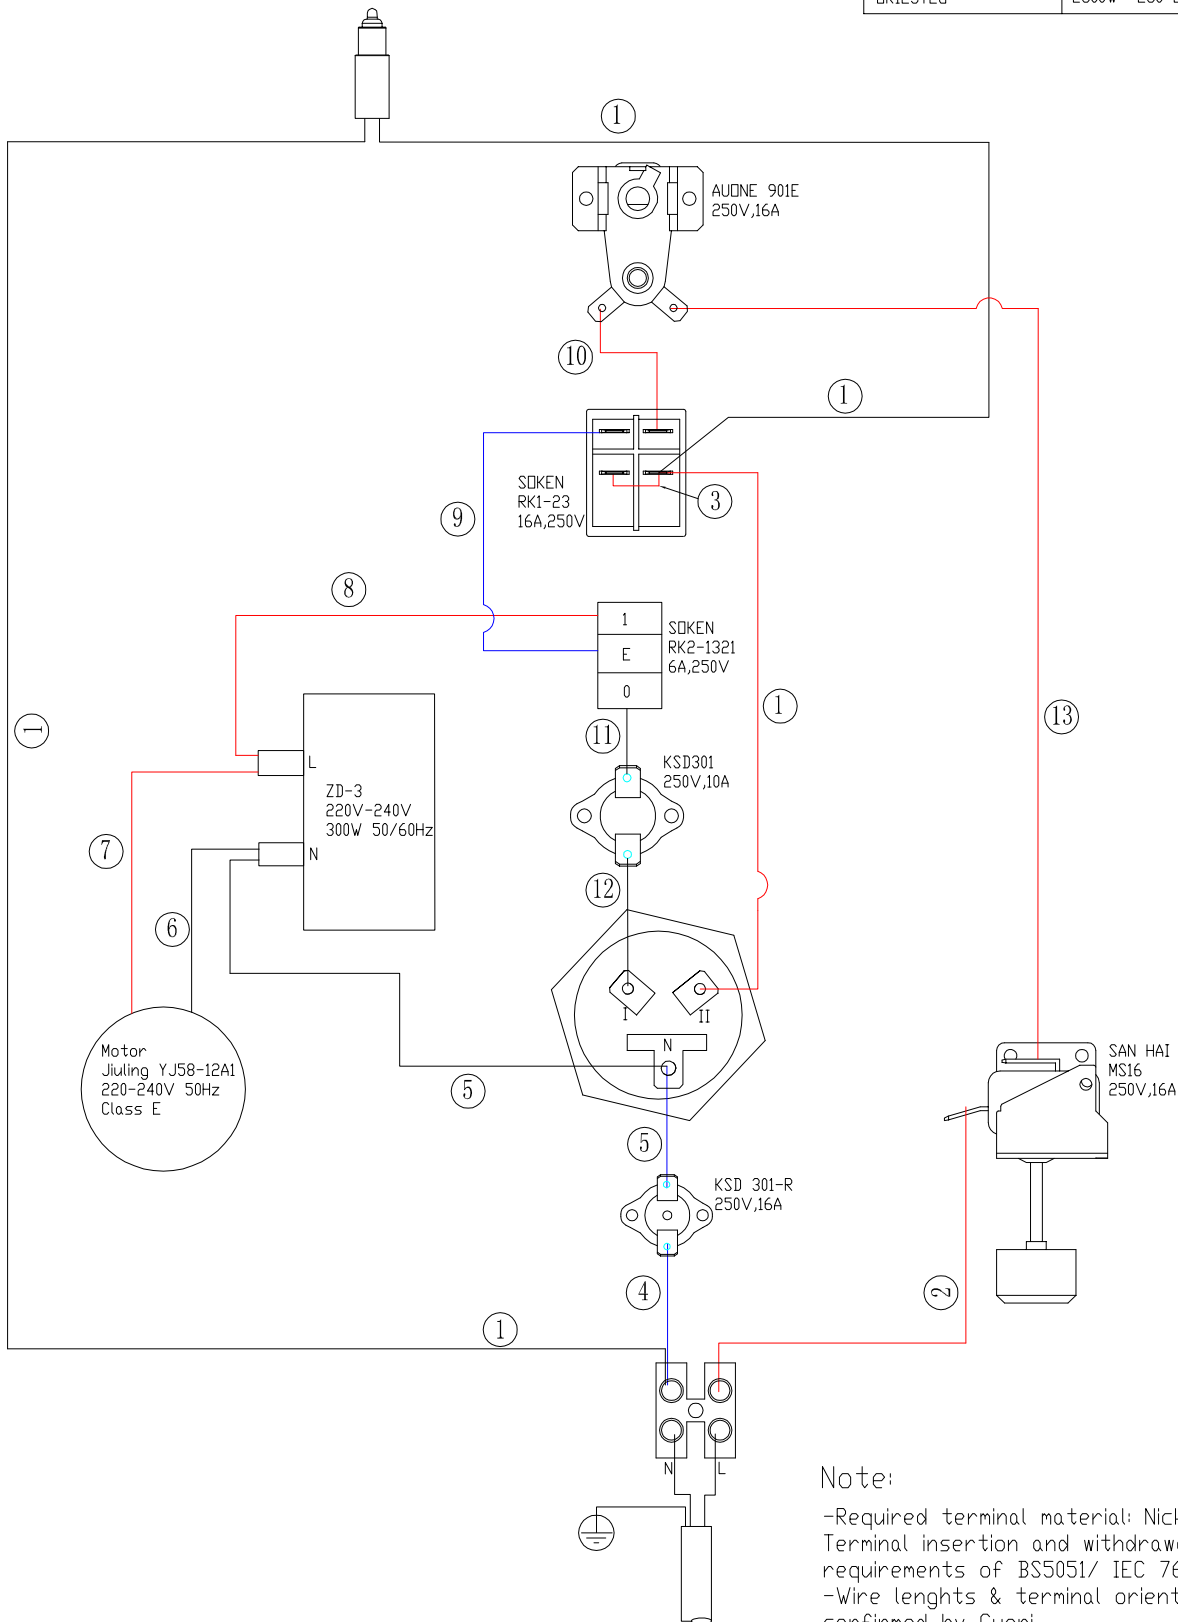

Note:
 -Required terminal material: Nickel Plated Steel Terminal insertion and withdrawal force to meet requirements of BS5051/ IEC 760
 -Wire lengths & terminal orientation/type to be confirmed by Cuori

ISSUE	MODIFICATIONS	APPD	DATE	NOTES	GLEN DIMPLEX RESEARCH & DEVELOPMENT				THIS DRAWING IS SUPPLIED IN CONFIDENCE AND THE COPYRIGHT THEREOF IS THE PROPERTY OF GLEN DIMPLEX. IT MUST NOT BE USED BY A THIRD PARTY WITHOUT PRIOR PERMISSION. ©2006	
A	RELEASE FOR SAMPLING	RW	27/05/08	All wires to be 1.5mm ² Neon function: operating	Dunleer, Co.Louth, Ireland. Tel: 041 9800204. Fax: 041 6851464.				PROJECT <i>Oil Column-EWT TURBO</i>	
B	MODEL REFERENCES UPDATED	JH	27/05/08	Tolerance on all wire lengths +/-5mm	DRAWN BY RW	DATE 27/05/08	SCALE	HOLE TOL +/-0.05	GEN TOL 0 +/-0.4 0,0 +/-0.2 0,00+/-0,1	TITLE WIRING DIAGRAM
				DO NOT SCALE IF IN DOUBT ASK	APP'D BY	DATE	DIM IN mm	ANGLES +/-0.5'	DRG NO <i>0/11500/0</i>	NO. OFF. A4 Sht 1 of 1
					R.o.H.S. All material must comply with the requirements of European Directive 2002/95/EC on the restriction of the use of certain hazardous substances.					