


Dimension 'C' is taken from door seal lip (fire box) to the front of the floor protector. All dimensions are in millimetres. All dimensions are set as a minimum guide only.

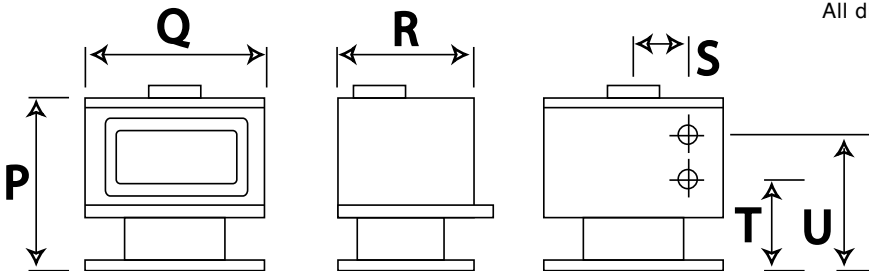


Classic C/A Clearance requirements with 1200mm flue shield

A	B	C	D	E	F	G	H	J	K	L	M	N	P	Q	R	S	T	U
75	250	300	200	50	225	570	355	1045	820	1105	940	600	700	645	445	150	320	495

Industry Rated Peak Output (kW)	Water Heating Option	Floor Protector
17	Rural Only	Non Insulated

IF INSTALLED IN ACCORDANCE WITH THESE SPECIFICATIONS THE HEATER COMPLIES WITH AS/NZS 2918:2001 (A.R.S Report No. 03/917)

RETAIL LINKS RESERVE THE RIGHT TO CHANGE SPECIFICATIONS OR DESIGNS WITHOUT PRIOR NOTICE

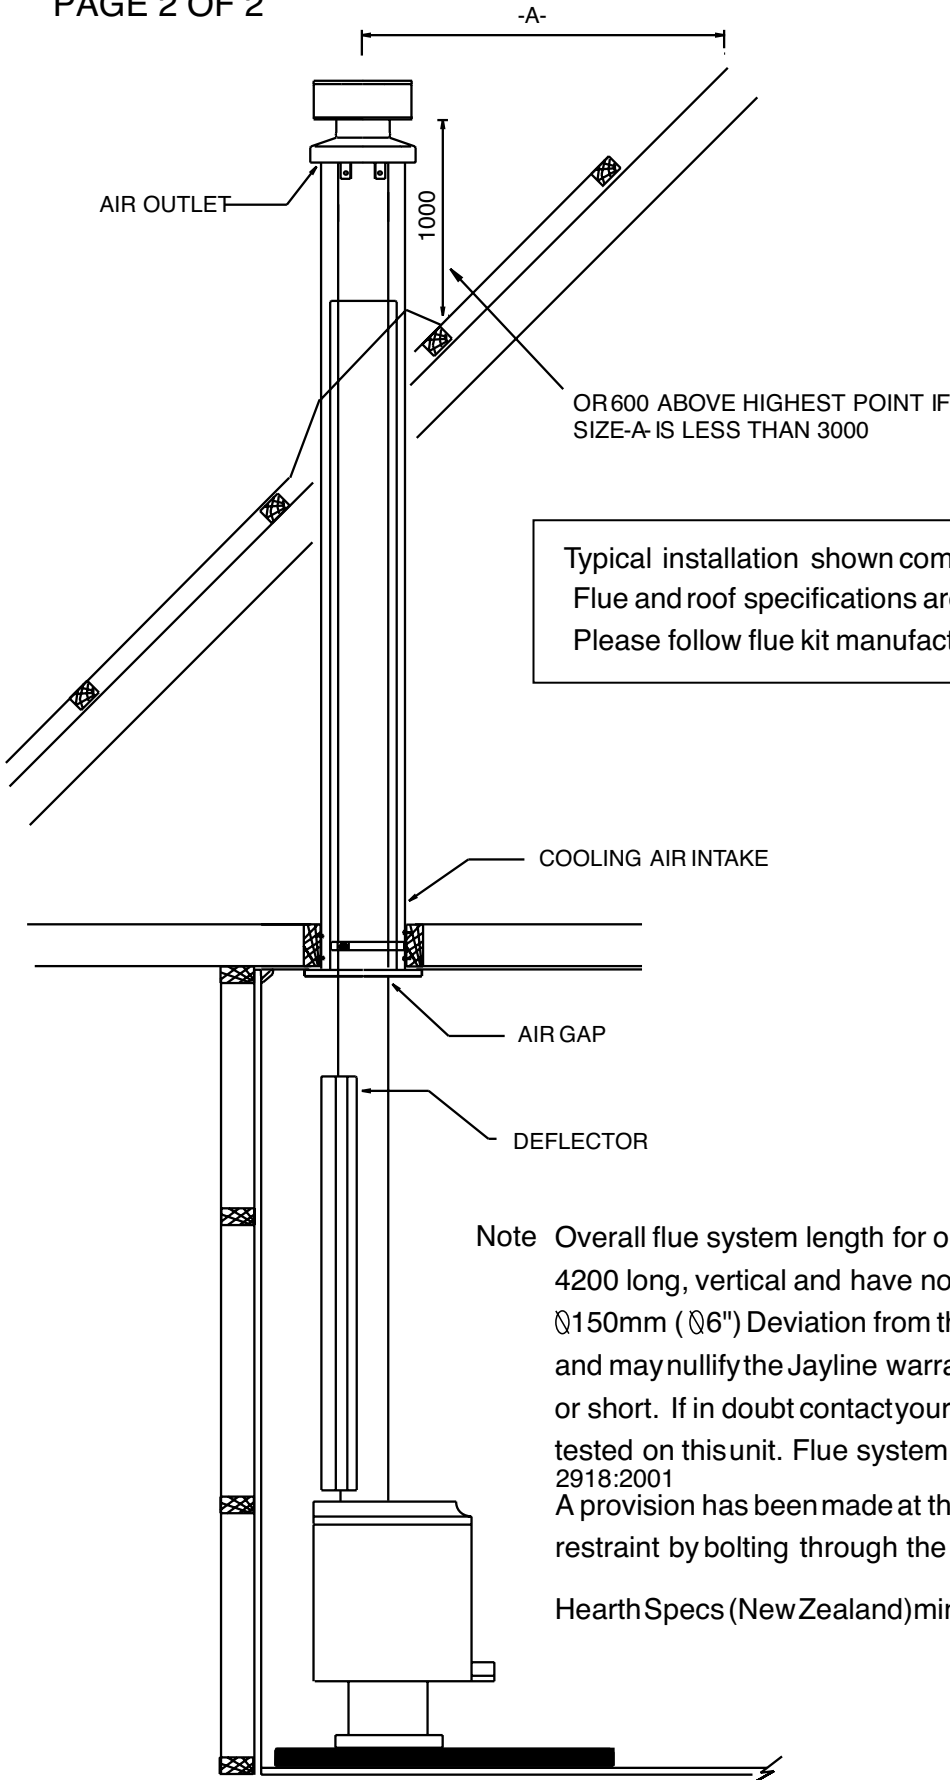

Typical installation shown complies with AS/NZS 2918:2001
Flue and roof specifications are recommendations only.
Please follow flue kit manufacturers installation instructions.

Note Overall flue system length for optimum performance should be 4200 long, vertical and have no bends. Flue pipes should be $\varnothing 150\text{mm}$ ($\varnothing 6''$) Deviation from this may alter the heaters performance and may nullify the Jayline warranty if the flue is excessively long or short. If in doubt contact your Jayline supplier Stainless steel deflect or tested on this unit. Flue system must comply with Appendix F of AS/NZS 2918:2001
A provision has been made at the rear of the pedestal for seismic restraint by bolting through the two holes provided

HearthSpecs (New Zealand) minimum non insulated floor protector only.

IF INSTALLED IN ACCORDANCE WITH THESE SPECIFICATIONS THE HEATER COMPLIES WITH AS/NZS 2918:2001 including appendix F

RETAIL LINKS LTD RESERVE THE RIGHT TO CHANGE SPECIFICATIONS OR DESIGNS WITHOUT PRIOR NOTICE.